

Technical data

P4225 Self contained wall mounted
(Switch Tripping) unit

24 volt battery pack and float charger
(Standing load type with alarms)

10.0Ah supply for powering coils, protection relays etc.

Trauma tested to ensure safe power under extreme conditions

Battery
Charger
Alarms
Casing, etc
Standards and testing

Unit designed and manufactured by Slencrest Ltd. 01622 741122
Document first published 07/02

Battery pack 2No. P4295

Sealed
Lead-Acid

Type

24 volt

Nominal voltage

2 x 12

Number of cells (two packs wired in parallel)
Taped and shrink-wrapped

10Ah

Rated capacity (2 x 5Ah)

22.4 volt

Minimum discharge voltage at battery terminals
whilst supplying standing load (5°C)

22.4 volt

Minimum discharge voltage at battery terminals
whilst supplying standing load and undertaking
tripping/inter-tripping duty (5°C)

Wound Lead
(pasted)

Construction of negative and positive plates

10 years

Design float life at 25°C

Cyclon 'X'

Manufacturer's cell type

1.8 amps

Float charge rate

28.56±0.3V

Float voltage

Charger

Input

110/240V	Voltage
Single	Phase
50Hz/60Hz	Frequency

Output

Two	Number of outputs
32A Redspot	Value & type
1A @28.56V	Rated float current at float voltage
27-32V 28.56V	Float voltage adjustment range Nominal setting
0.7A-2.0A 1.8A	Float current adjustment range Nominal setting
Better than .05% for +6% to -10%	Output voltage regulation for mains voltage variation
6 hours	Recharge time after full discharge

Alarms

2 (normally open) relay contacts available for each alarm circuit

Charger fail

21-32V Adjustment range
24V Nominal setting

1-10 sec Time delay adjustment range
5 sec Nominal setting

Battery volts low

20.2-29V Adjustment range
20.8V Nominal setting

35msec Time delay setting

Battery volts high

29-39V Adjustment range
30V Nominal setting

1-10 sec Time delay adjustment range
5 sec Nominal setting

Charger isolated Additional safety action on alarm

Visual warnings (see Front panel)

Green LED Healthy system indicator
Red LED Mains power supply on

Casing

Dimensions (approx)

500mm High

500mm Wide

300mm Deep with bolt positions for fixing to wall

9KG Complete battery pack

28KG Unit not including battery

Front panel

Switch for main supply On/Off

Spring loaded test switch that inserts 4.7 amp load

Voltmeter with range 0-40 volts

5 amp fuse for mains charger input

7 amp fuse for protection of transformer

1 amp fuse for protection of alarm panel under fault conditions

Healthy system indicator LED (green)

Mains power supply on LED (red)

Cabling

Spring loaded DIN connectors for all external wiring through removable gland plate (see drawing 422519)

Standards and testing

Batteries to BS 6290


Unit designed to ESI standard 50-18

Complies with Engineering Standard 3-0301 (Switchgear)

Fully tested

Enclosure complies with IP31 for indoor mounting

ISSUE	ALTERATION	BY	DATE
1		DAF	21/6/02

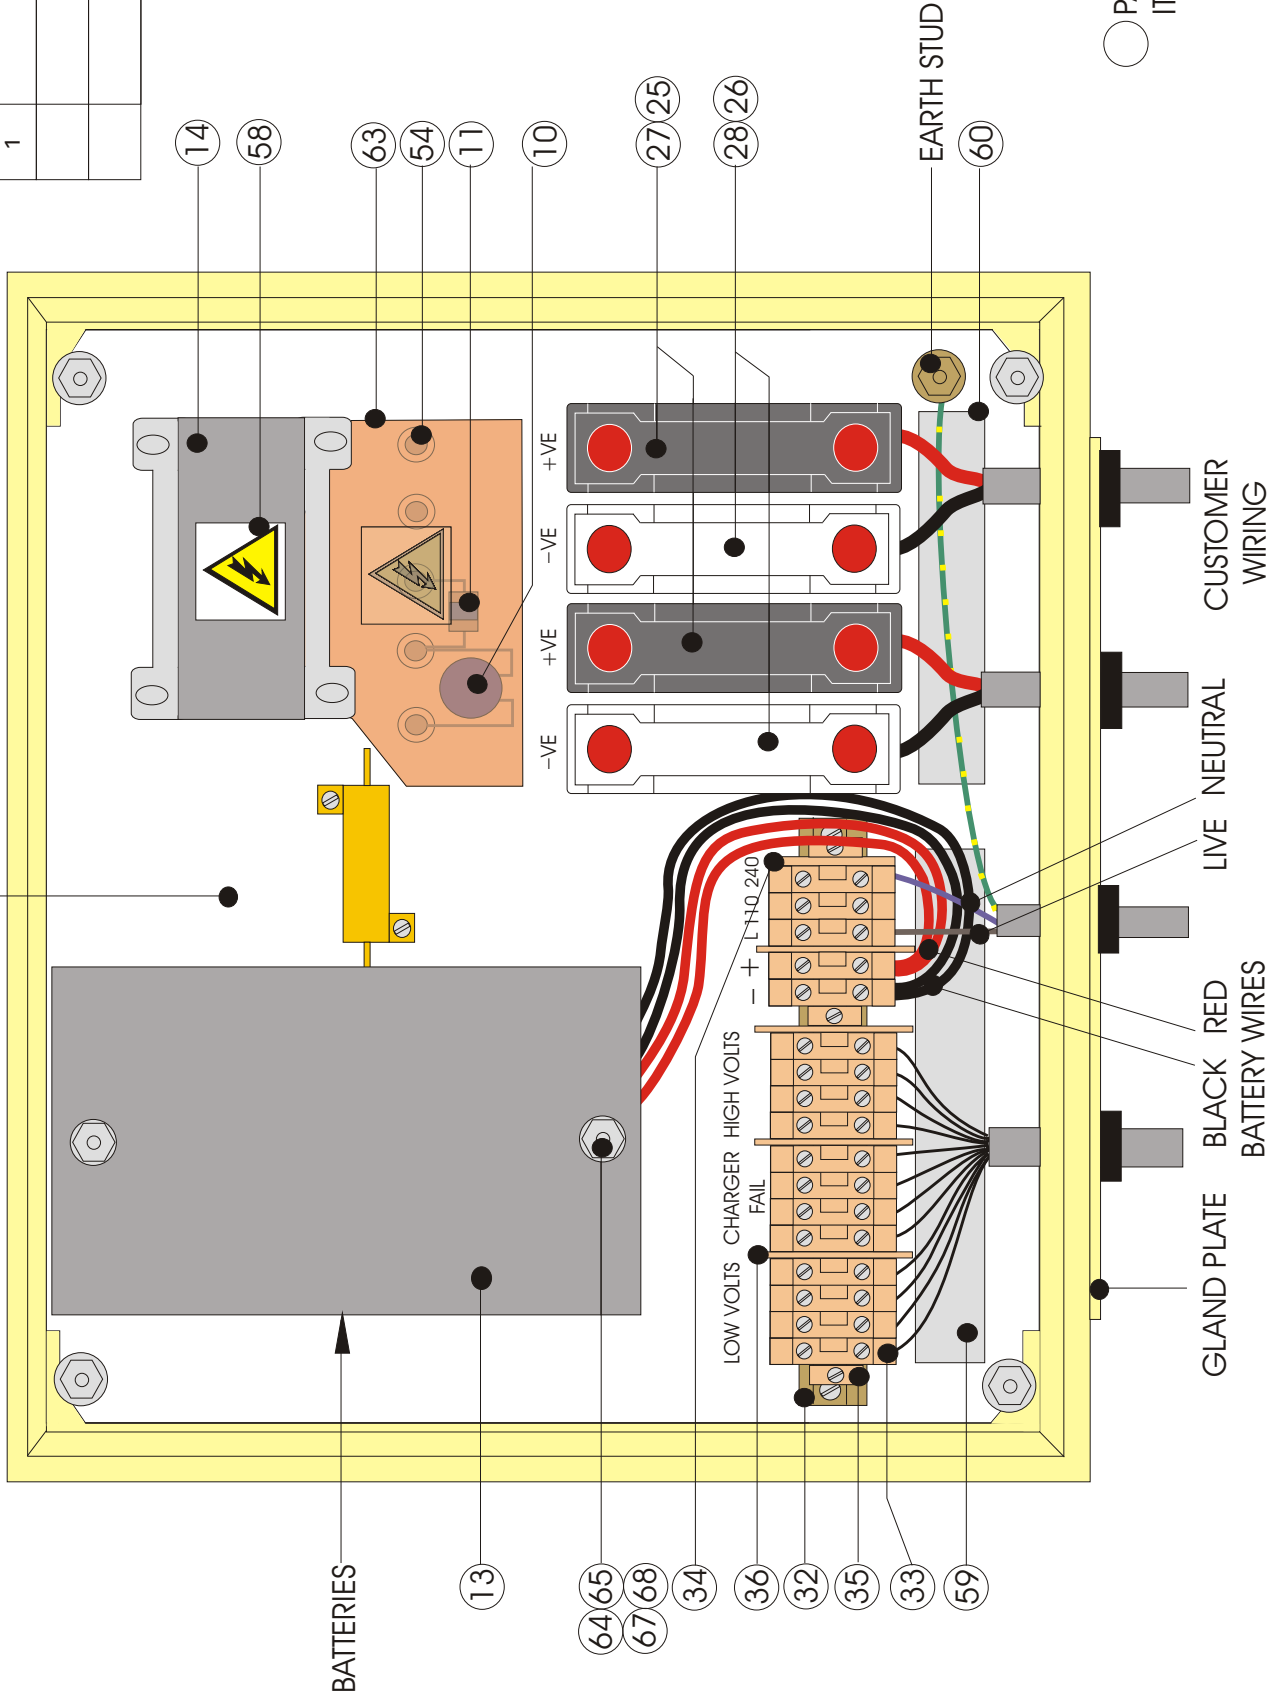

○ PARTS LIST
ITEM NUMBER

DRAWING No.
422519
DRN: DAF ENGR SSM

This Drawing and information hereon is the property of SLENCREST Ltd; and must not be disclosed, loaned, copied, or used for manufacturing, tendering or for any purpose without their WRITTEN permission.

SLENCREST LIMITED BROAD OAK HOUSE PHEASANT LANE MAIDSTONE KENT ME15 9QR	TITLE GA INSIDE UNIT SHOWING CUSTOMER WIRING MODEL 4225	SCALE :-	TOLERANCES :-
		DIMENSIONS :-	